

# Tollaust Pty Ltd

## Lane Cove Tunnel

CO In Tunnel Air Quality Monitoring

Validated Report

1<sup>st</sup> May 2015 – 31<sup>st</sup> May 2015

Report No.: DAT9538

Report issue date: 05/06/2015

Maintenance contract: MC1072

*ECOTECH PTY LTD. ABN: 32005752081*

*1492 Ferntree Gully Rd, Knoxfield VIC. 3180. AUSTRALIA*

*Tel No: 1300 364 946 Fax No: 1300 668 763*

*Email [ecotech@ecotech.com](mailto:ecotech@ecotech.com) WEB [www.ecotech.com](http://www.ecotech.com)*

This document shall not be reproduced except for in full, without the written approval of Ecotech Pty Ltd.

---

# Lane Cove Tunnel & Military Road E-Ramp

Report No: DAT9538


Tollaust Pty Ltd

Customer Details	
Customer	Tollaust Pty Ltd
Contact name	Greg Byrnes
Address	5 Sirius Road, Lane Cove West, NSW 2066
Email	<a href="mailto:GByrnes@transurban.com">GByrnes@transurban.com</a>
Phone	(02) 9937 1240

Revision History			
Revision	Report ID	Date	Analyst
0	DAT9538	05/06/2015	David Ding

Report by:

David Ding

  
\_\_\_\_\_

Approved Signatory:

Jon Alexander

  
\_\_\_\_\_

### Table of Contents

Customer Details.....	2
Revision History .....	2
Table of Contents.....	3
List of Figures .....	4
List of Tables .....	4
Executive Summary.....	5
1.0 Introduction .....	6
2.0 Monitoring and Data Collection.....	6
2.1. Siting Details.....	6
2.2 .Monitored Parameters.....	9
2.3. Data Collection Methods .....	10
2.3.1. Compliance with Standards .....	10
2.3.2. Data Acquisition .....	10
2.3.3. Validation .....	10
2.3.4. Reporting.....	11
3.0 Air Quality Goals .....	12
4.0 Calibrations and Maintenance .....	13
4.1.Units and Uncertainties .....	13
5.0 Results .....	14
5.1. Data Capture .....	14
5.2. Air Quality Summary .....	16
5.3. Graphic Representations .....	17
Report Summary .....	20
Appendix 1 - Definitions & Abbreviations.....	21

### List of Figures

Figure 1: Lane Cove monitoring network.....	8
Figure 2: CO exposure and single point 3 minutes rolling averages for May 2015 .....	17
Figure 3: CO exposure and single point 15 minutes rolling averages for May 2015 .....	17
Figure 4: CO exposure and single point 30 minutes rolling averages for May 2015 .....	18
Figure 5: CO exposure and single point 3 minutes rolling averages from March 2015 to May 2015 (3 monthly trend).....	18
Figure 6: CO exposure and single point 15 minutes rolling averages from March 2015 to May 2015 (3 monthly trend).....	19
Figure 7: CO exposure and single point 30 minutes rolling averages from March 2015 to May 2015 (3 monthly trend).....	19

### List of Tables

Table 1: Locations and parameters for In-tunnel open path type air quality monitoring.....	7
Table 2: Parameters measured at the Lane Cove monitoring network.....	9
Table 3: Methods .....	10
Table 4: Station/Network Air Quality Goals.....	12
Table 5: Units and Uncertainties.....	13
Table 6: Monthly Data Capture for Lane Cove Tunnel & Military Road E-Ramp monitors for May 2015....	15
Table 7: Exceedences Recorded for May 2015 .....	16

### Executive Summary

The Lane Cove Tunnel is located in Sydney, Australia and is a 3.6 km twin tunnel motorway under Epping Road that links the M2 Motorway at North Ryde with the Gore Hill Freeway at Artarmon. Ecotech Pty Ltd is contracted by Tollaust Pty Ltd to undertake reporting services for the air quality monitoring system inside the tunnel which ensures that the carbon monoxide (CO) levels inside the Tunnel are always kept to within levels and limits stipulated by the Ministers Conditions of Approval (MCoA) for the Lane Cove Tunnel.

Continuous measurements of CO inside the tunnel are recorded, validated and reported to Tollaust Pty Ltd on a monthly basis.

Maintenance and calibrations are performed by a third party contractor.

This report presents validated data for the month of May 2015.

During the reporting period of May 2015, there were no observed exceedences of CO limits stipulated by the Department of Planning inside the tunnel.

## 1.0 Introduction

Ecotech is an independent company contracted by Tollaust Pty Ltd to undertake in tunnel air quality reporting at the Lane Cove Tunnel.

This report presents the validated data for May 2015.

- Describes air quality measurements;
- Reports any readings above the LCT limits;
- Compares monitoring results;
- Has been quality assured;

## 2.0 Monitoring and Data Collection

### 2.1. Siting Details

The CO In tunnel monitoring network consists of

- Twenty eight separate CO monitors attached to the walls and portals of both eastbound and westbound tunnels

# Lane Cove Tunnel & Military Road E-Ramp

Report No: DAT9538

Tollaust Pty Ltd

**Table 1: Locations and parameters for In-tunnel open path type air quality monitoring**

Monitoring Location	Parameters Measured
	CO
A	x
B	x
C	x
F	x
G	x
H	x
I	x
J	x
M	x
N	x
Q	x
R	x
S	x
T	x
U	x
V	x
W	x
X	x
Y	x
Z	x
AA	x
AB	x
AC	x
AG	x
AH	x
AI	x
AJ	x
AK	x
AL	
AM	
AN	
TOTAL	28

Non-highlighted rows – tunnel wall monitors; light grey highlighted rows – portal located monitors; dark grey highlighted rows –in ventilation stack monitors

# Lane Cove Tunnel & Military Road E-Ramp

## Report No: DAT9538

Tollaust Pty Ltd

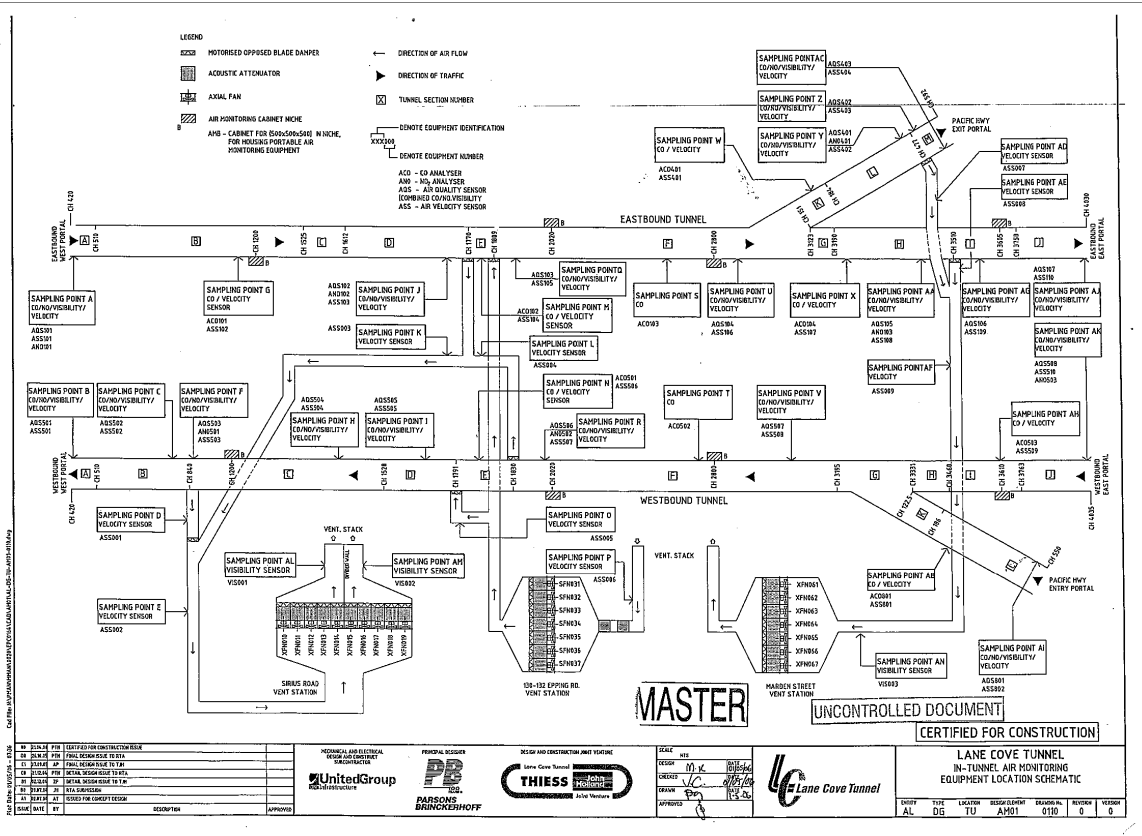


Figure 1: Lane Cove monitoring network



### 2.2. Monitored Parameters

Table 1 below details the parameters monitored and the instruments used at the monitoring network. Appendix 1 defines any abbreviated parameter names used throughout the report.

**Table 2: Parameters measured at the Lane Cove monitoring network**

Parameter Measured	Instrument and Measurement Technique
CO	CODEL TunnelCraft III AQM – Infrared Gas Cell Correlation.

### 2.3. Data Collection Methods

Table 3 below shows the methods used for data collection. Any deviations from the stated methods are detailed in section 2.3.1.

**Table 3: Methods**

Parameter Measured	Data Collection Methods Used	Description of Method
CO	Codel Tunnel Master Open Path - infrared	This method involves projecting an infrared beam across a 3 metre section of the tunnel into a reflector and the reflected light is received by a transceiver which measures the specific absorption

Carbon monoxide (CO) levels are measured inside the tunnel using a network of 28 separate CO monitors attached to the walls of both eastbound and westbound tunnels. The monitors measure CO using an analytical method known as non-dispersive infra-red absorption with gas filter correlation. An infra-red beam is projected across a 3 metre section of the tunnel and the amount of infra-red light absorbed by CO molecules in the path of the beam is measured. The quantity of infra-red light absorbed is proportional to the concentration of CO in the path of the beam. The monitors used were specially designed for use in road tunnels where access for routine essential maintenance is restricted by the need to minimise traffic disruption. Similar monitors are widely used in other road tunnels in Australia and worldwide.

The CO method of analysis is similar to the standard method AM-6 outlined in “NSW EPA 2001, Approved Methods for Sampling and Analysis of Pollutants in New South Wales.” However the method differs from the standard principally by the use of the open beam type instrument as described above in place of a closed analytical cell and sample delivery pump as typically used in ambient air monitoring stations. This deviation from the standard method has been approved by the Department of Planning on the advice of an independent consultant with specialist expertise in the field of air quality monitoring.

#### 2.3.1. Compliance with Standards

Unless stated below, parameters are monitored at the Lane Cove Tunnel & Military Road E-Ramp stations according to the methods detailed in Table 3 above.

#### 2.3.2. Data Acquisition

Data acquisition is performed using the LCT-MRE Pty Ltd hardware and software on a weekly basis. The recorded data is remotely collected from the remote PC on a daily basis (using Airodis™ version 5.0) and stored at Ecotech’s Environmental Reporting Services (ERS) department in Melbourne, Australia. Data samples are logged in 1 minute intervals. Data Validation and Reporting

#### 2.3.3. Validation

Ecotech ERS maintains two distinct databases containing non-validated and validated data respectively.

The validated database is created by duplicating the non-validated database and then flagging data affected by instrument faults, calibrations and other maintenance activities. The data validation software requires the analyst to supply a valid reason (e.g. backed by maintenance notes, calibration sheets etc) in the database for flagging any data as invalid.

Details of all invalid or missing data are recorded in the Valid Data Exception Tables.

Validation is performed by the analyst, and the validation is reviewed. Graphs and tables are generated based on the validated one minute data.

Validation is limited by the information provided by Tollaust.

### 2.3.4. Reporting

The reported data is in a Microsoft Excel format file named "Data LCT CO In Tunnel May15\_ Validated.xls" included as an appendix to this report.

The Excel file(s) consists of 3 Excel worksheets:

1. Cover
2. Max Single Point 3, 15 and 30 m
3. Valid Data Exception Table

The data contained in this report is based on Australian Eastern Standard Time.

All averages are calculated from the one minute data. Averages are based on a minimum of 75% valid readings within the averaging period.

Averaging periods of eight hours or less are reported for the end of the period, i.e. the hourly average 02:00am is for the data collected from 1:00am to 2:00am. One hour averages are calculated based on a clock hour.

### 3.0 Air Quality Goals

The air quality goals for pollutants monitored at the Lane Cove Tunnel & Military Road E-Ramp monitors are based on the Ministers Conditions of Approval (MCoA) for the Lane Cove Tunnel. The air quality goals are shown in Table 4 below.

**Table 4: Station/Network Air Quality Goals**

Parameter	Time Period	Exceedence Level	Units	Applicable MCoA
CO	30 minutes rolling averages	50	ppm	MCoA 160
	15 minutes rolling averages	87	ppm	MCoA 160
	3 minutes rolling averages	200	ppm	MCoA 161

### 4.0 Calibrations and Maintenance

#### 4.1. Units and Uncertainties

The uncertainties for each parameter have been determined by the manufacturer’s tolerance limits of the equipment’s parameters, and by the data collection standard method.

The reported uncertainties are expanded uncertainties, calculated using coverage factors which give a level of confidence of approximately 95%.

**Table 5: Units and Uncertainties**

Parameter	Units	Resolution	Uncertainty	Measurement Range
CO	ppm	0.1 ppm	± 1.0 ppm or 2% of span	0 ppm to 100 ppm

## 5.0 Results

### 5.1. Data Capture

Data capture is based on 1 minute data, and refers to the amount of available data collected during the report period.

The percentage of data captured is calculated using the following equation:

$$\text{Data capture} = (\text{Reported air quality data} / \text{Total data}) \times 100\%$$

Where:

- Reported air quality data = Number of instrument readings which have been validated through a quality assured process and excludes all data errors, zero data collection due to calibration, failures and planned and unplanned maintenance.
- Total data = Total number of instrument readings since the start of the term assuming no maintenance, errors, loss of data or calibration.

Table 6 below displays data capture statistics for May 2015.

Details of all invalid or missing data affecting data capture are included in the Valid Data Exception Table, see attached Excel file.

# Lane Cove Tunnel & Military Road E-Ramp

Report No: DAT9538

Tollaust Pty Ltd

Table 6: Monthly Data Capture for Lane Cove Tunnel & Military Road E-Ramp monitors for May 2015

CO	
Monitoring Location	Data Capture (%)
ACO101	99.9
ACO102	93.2
ACO103	84.9
ACO104	99.9
ACO401	99.9
ACO501	99.9
ACO502	99.2
ACO503	99.7
ACO801	99.9
AQS101	99.9
AQS102	99.9
AQS103	99.9
AQS104	99.9
AQS105	99.1
AQS106	99.9
AQS107	99.9
AQS401	99.9
AQS402	99.9
AQS403	99.9
AQS501	99.9
AQS502	99.9
AQS503	99.9
AQS504	99.9
AQS505	99.9
AQS506	95.9
AQS507	94.1
AQS508	99.3
AQS801	99.9

### 5.2. Air Quality Summary

Exceedences of the In Tunnel CO levels observed during the reporting period (if any) are recorded in the table below:

**Table 7: Exceedences Recorded for May 2015**

Parameter	Time Period	Value of Exceedence	Date of Exceedence	Station
CO	3 minutes rolling averages	-	-	-
	15 minutes rolling averages	-	-	-
	30 minutes rolling averages	-	-	-



5.3. Graphic Representations

Validated 1 minute data for CO were used to construct the following monthly graphic representations.

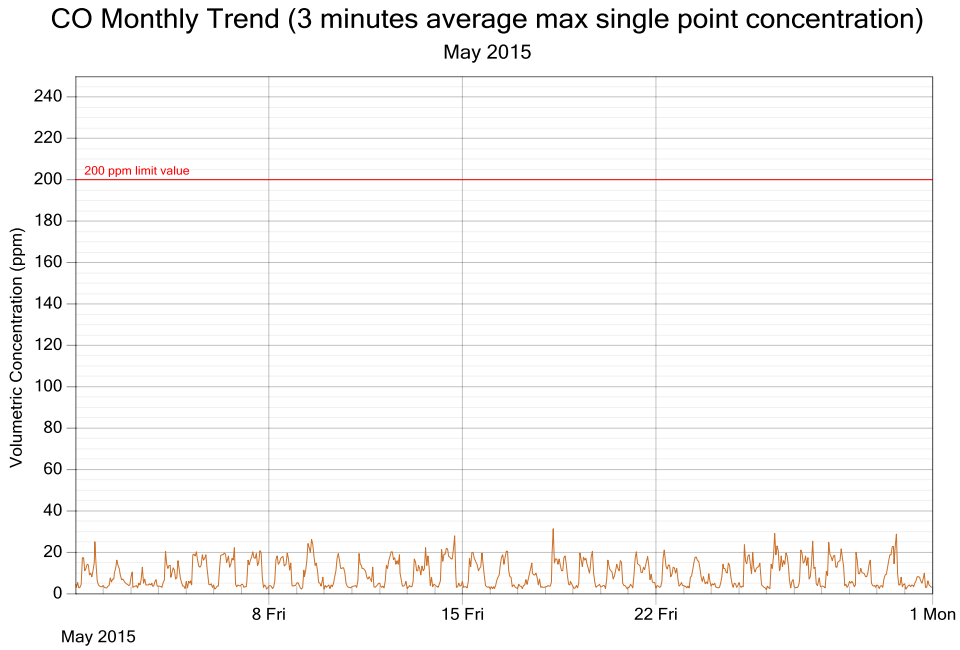


Figure 2: CO exposure and single point 3 minutes rolling averages for May 2015

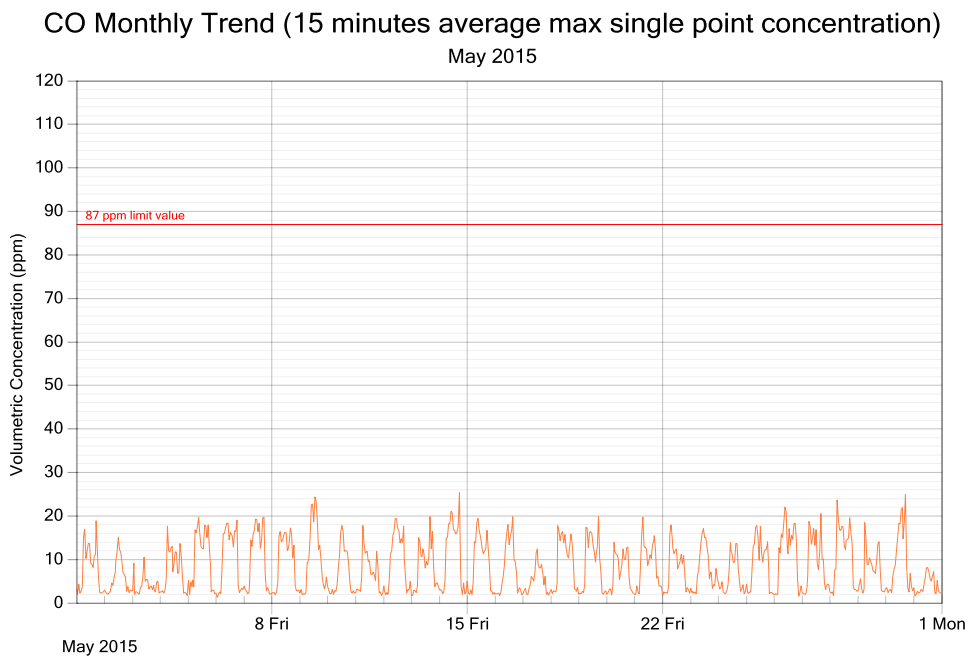


Figure 3: CO exposure and single point 15 minutes rolling averages for May 2015

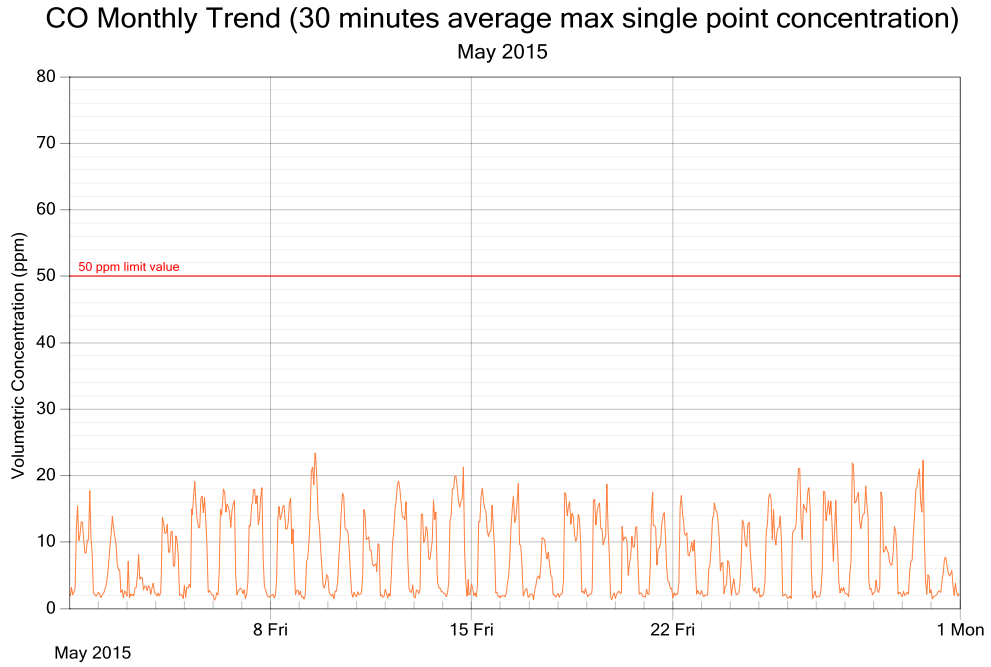


Figure 4: CO exposure and single point 30 minutes rolling averages for May 2015

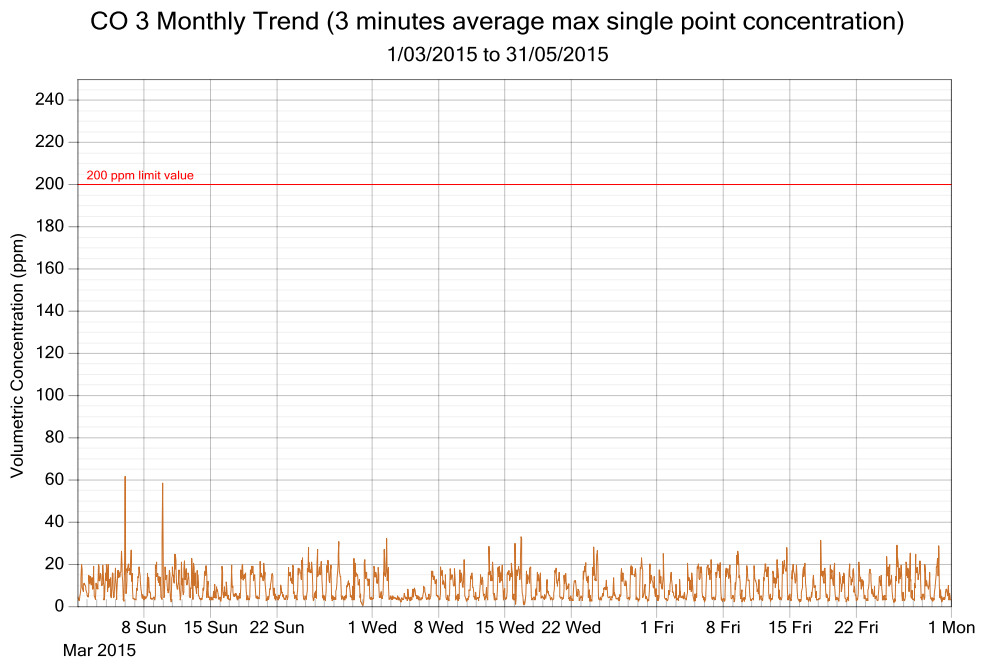


Figure 5: CO exposure and single point 3 minutes rolling averages from March 2015 to May 2015 (3 monthly trend)

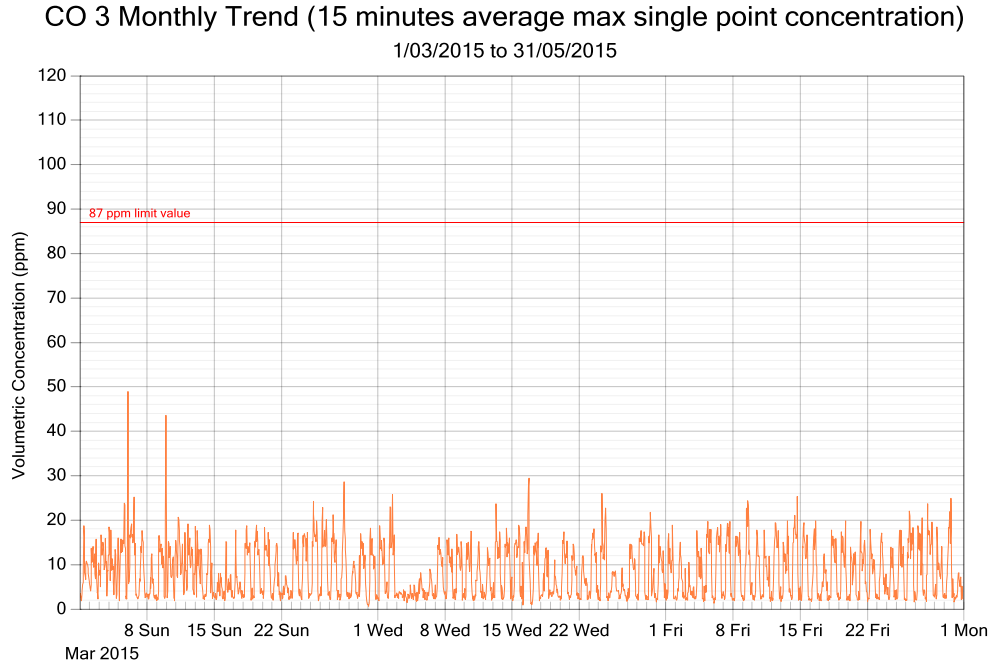


Figure 6: CO exposure and single point 15 minutes rolling averages from March 2015 to May 2015 (3 monthly trend)

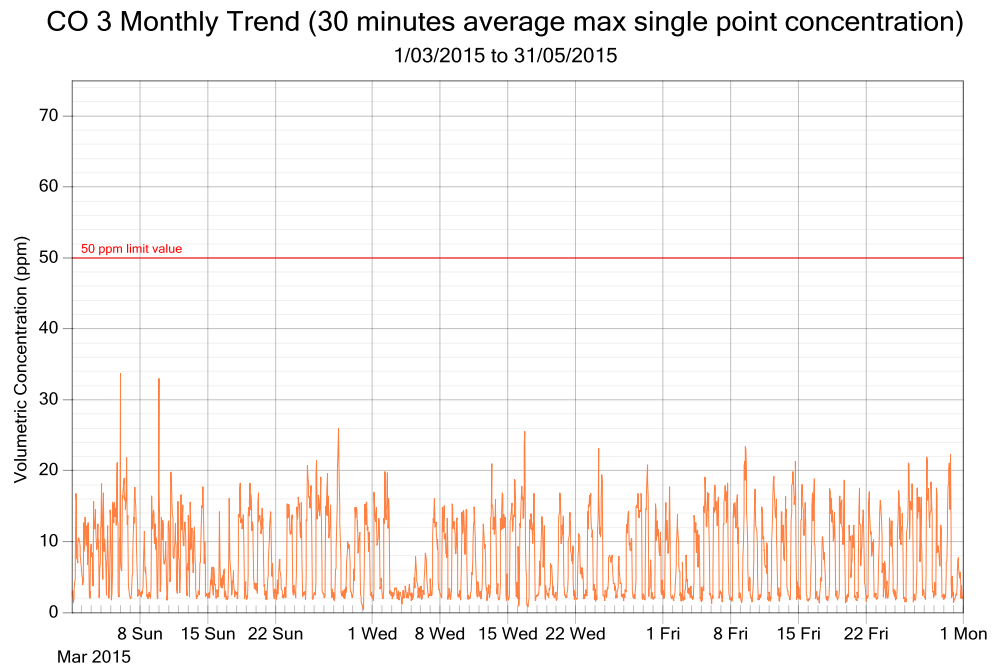


Figure 7: CO exposure and single point 30 minutes rolling averages from March 2015 to May 2015 (3 monthly trend)

### Report Summary

- During the reporting period of May 2015, there were no observed exceedences of CO limits stipulated by the Department of Planning inside the tunnel.

-----END OF REPORT-----

## Appendix 1 - Definitions & Abbreviations

CO            Carbon monoxide

ppm          Parts per million